

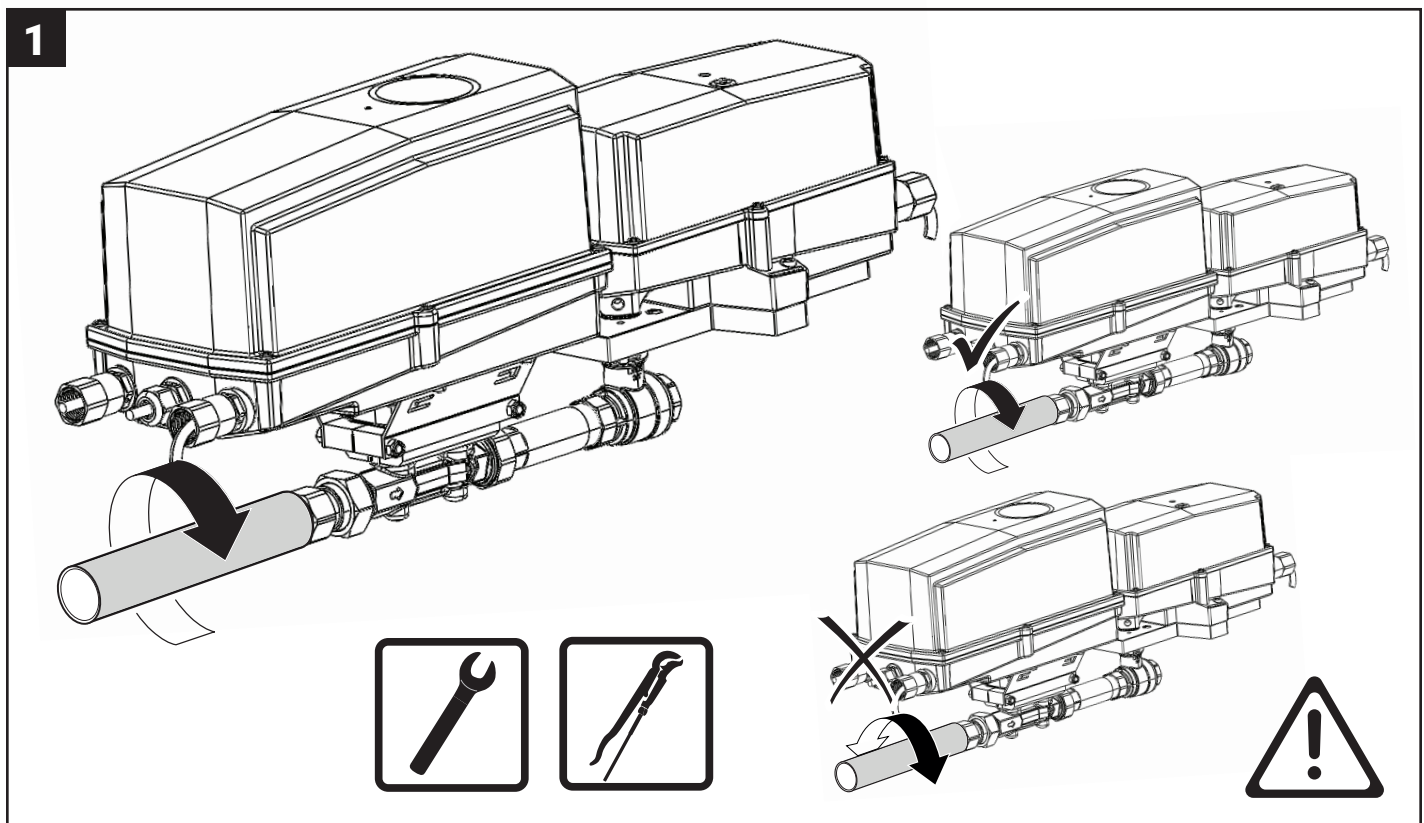





EPIV 4 NEMA 4

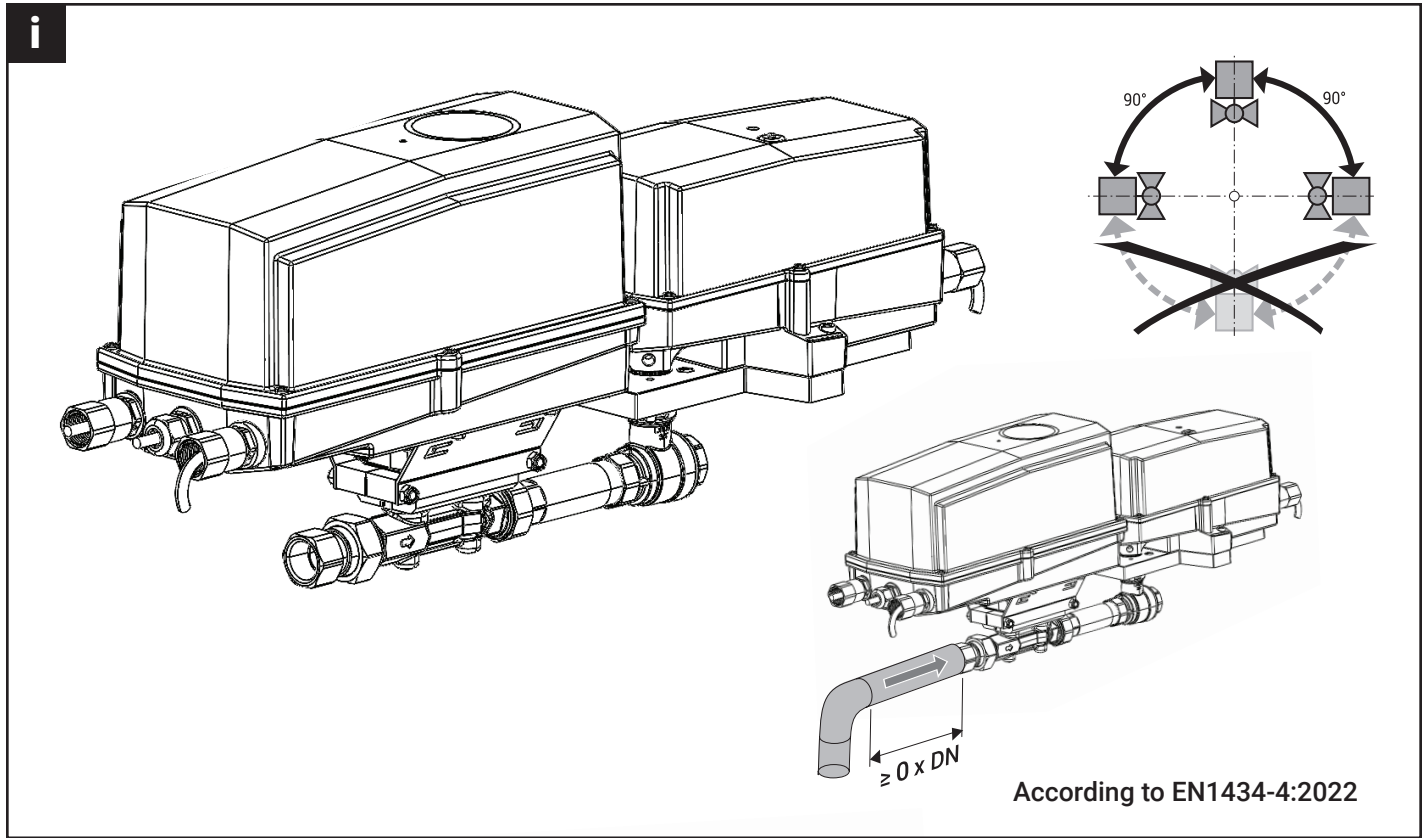

EPIV 4 NEMA 4




AC 24 V / DC 24 V




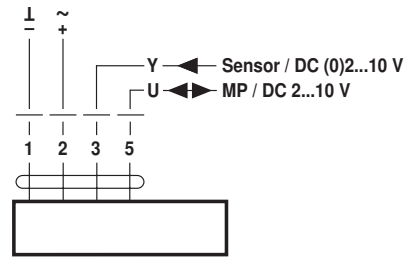
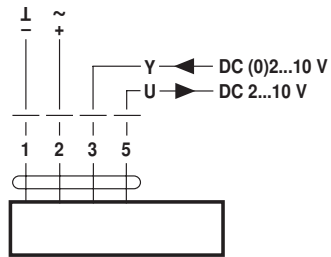


AC 24 V / DC 24 V


BACnet MS/TP / Modbus RTU

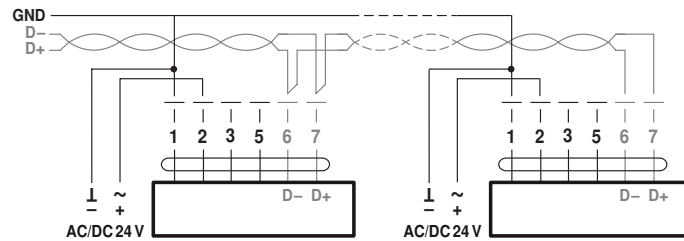

BACnet MS/TP / Modbus RTU / analog

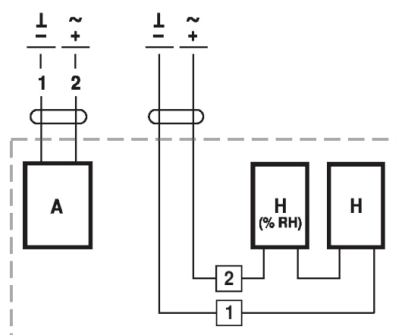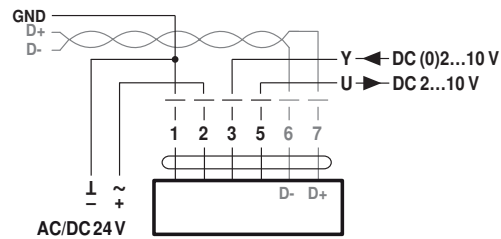

A = Actuator
H [% RH] = Humidistat
H = Heating

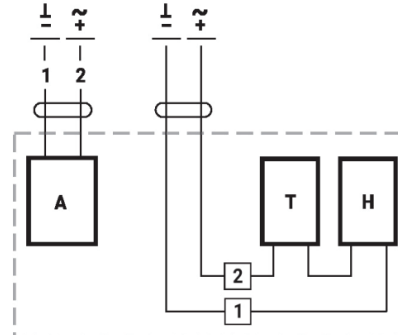

A = Actuator
T [°C] = Thermostat
H = Heating